

**NOTE:**

- ⊥ CHASSIS GROUND
- ⊥ CABINET GROUND
- CAPACITOR VALUES = MICROMICROFARADS EXCEPT AS NOTED
- RESISTOR VALUES = OHMS
- K = 1000
- MEG. = 1,000,000
- \* ALTERNATE TRANSFORMERS



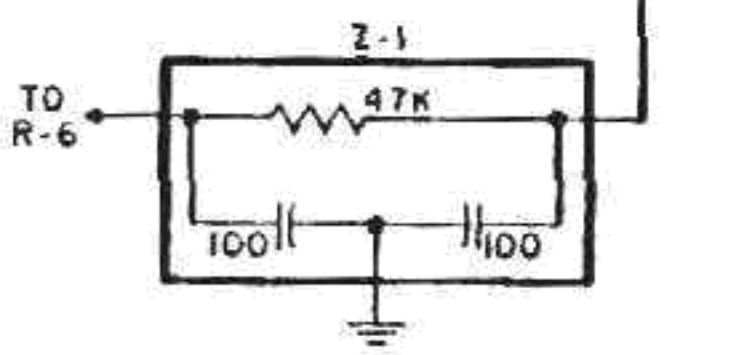


Figure No. 5. Schematic Diagram, SW-54 Receiver

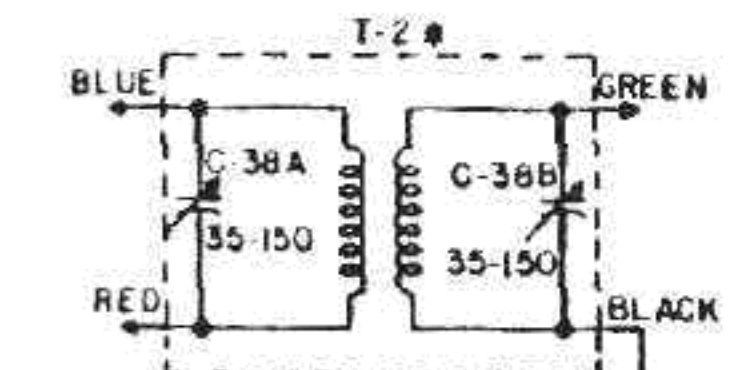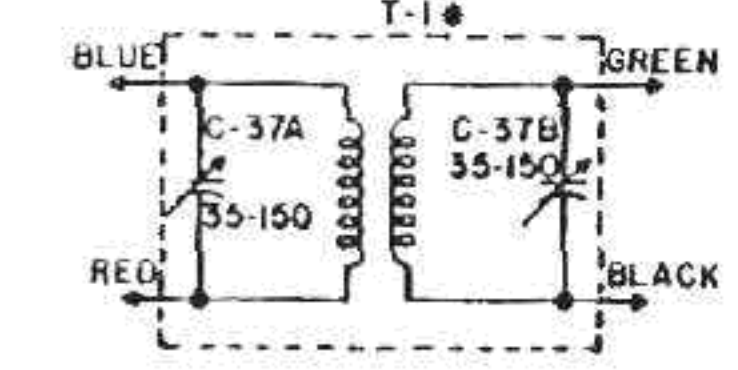